


This drawing includes confidential information which is the property of ASHCROFT INC. This copy is loaned for a specific purpose, with the understanding that it will not be reproduced or used for any other purpose or disclosed to others, and it will be returned on demand.

ASHCROFT® INC.

250 EAST MAIN STREET
STRATFORD, CT 06614

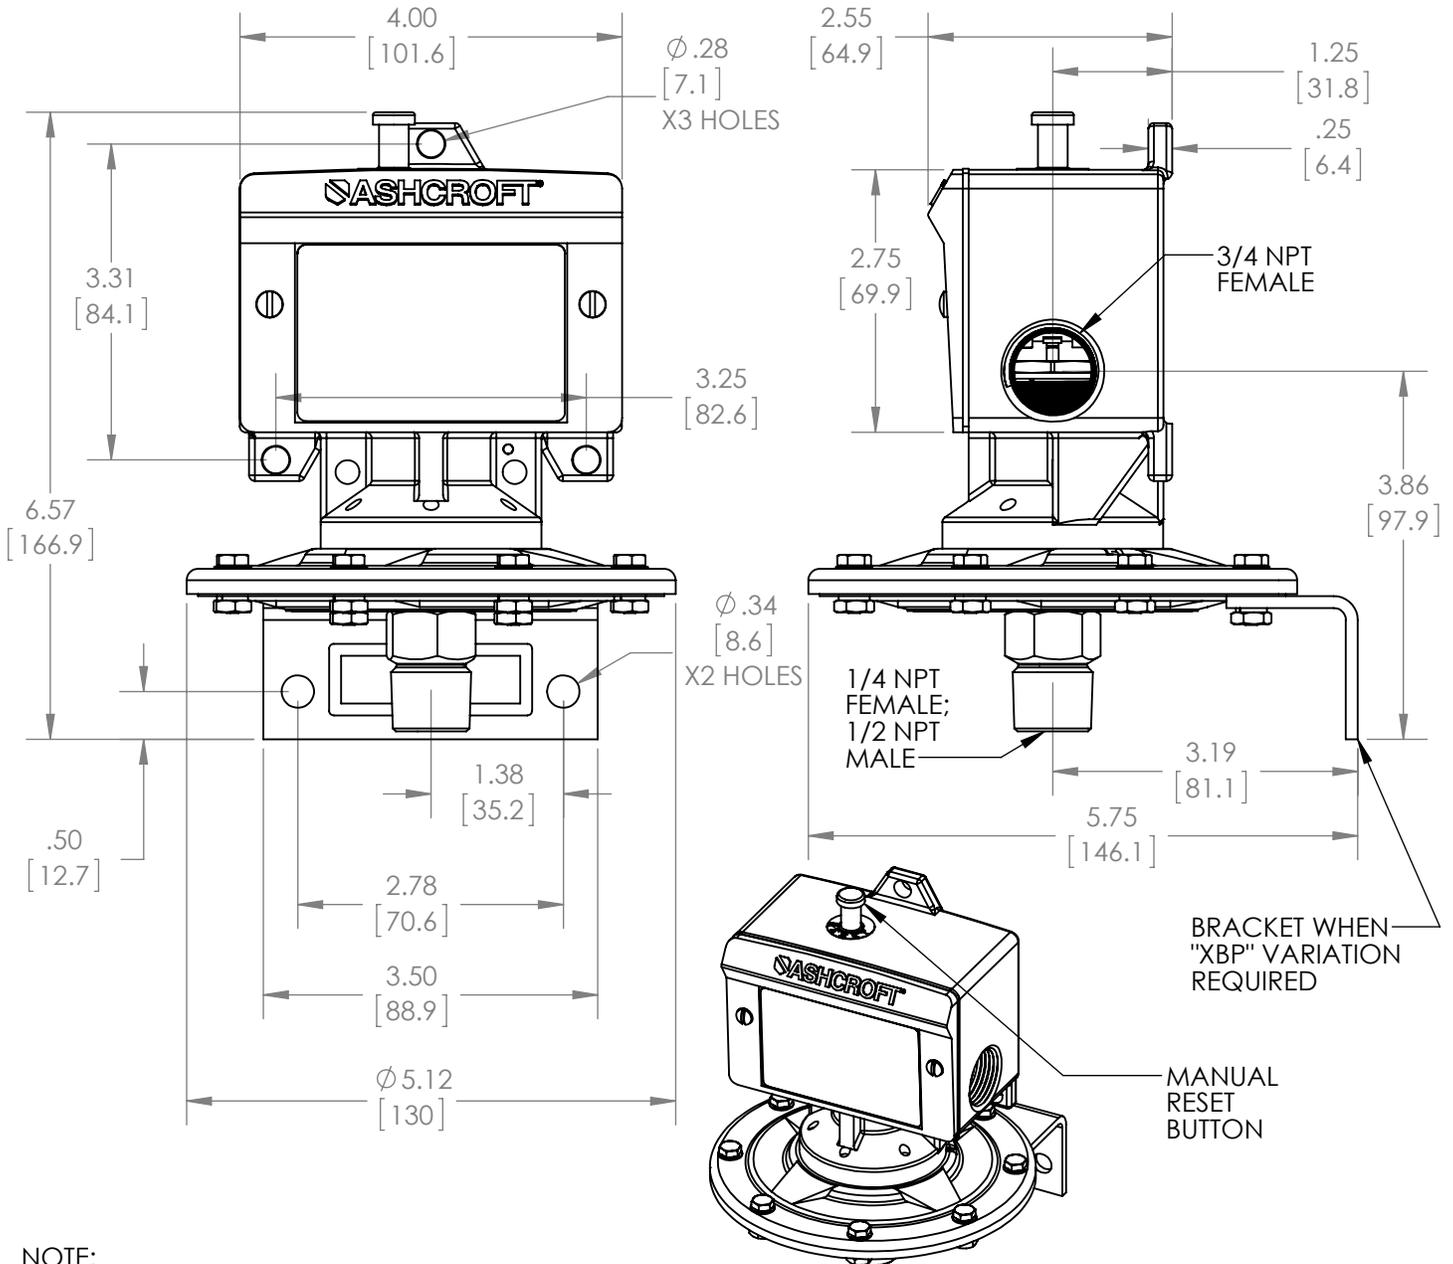

NOTE:
SWITCH CODE 28 IS FOR MANUAL RESET TRIP FOR INCREASING PRESSURE.
SWITCH CODE 29 IS FOR MANUAL RESET TRIP FOR DECREASING PRESSURE.

DIMENSIONS IN [] ARE MILLIMETERS

APPLICABLE SWITCH PRODUCT CODES					
SWITCH TYPE	SWITCH ELEMENT	SEAL MATERIAL	VARIATIONS	RANGE	
B4	28, 29	B, T, V	XBP06	10-150 IW	
REV.	ECO	DESCRIPTION		BY	DATE
A	0007530	RELEASE GENERAL DIMENSIONS		HOY	4/1/2015

This print certified correct for

Customer's Name

Customer's Order No.

Ashcroft Order No.

Certified by

Date

General Dimensions			
B4 PRESSURE SWITCH			
BUNA, TEFLON, VITON DIAPHRAGM MAT'L			
RANGES 10 – 150 IW - XBP06; MANUAL RESET			
Drawn	HOY	Date 4/1/15	Date of Issue
Checked	TB	Date 4/1/15	SHEET-1
Approved	SSH	Date 4/1/15	Rev.
70A4018			A